

0 ft. Above Ceiling Air Plenum 3 ft. 5 ft. 10 ft.

1'-2 5/16"

Questionable Vertical Clearance

Cable Troughs

Note: 5 600mm-wide racks ganged together with no gap -> 118 1/8" wide, not 120" wide.

1'-15/16"


9'-0"

ISOBase plate typically extend 1-2 inch beyond edge of rack enclosure

1'-0"

Min 9" between ISOBase and wall/objects

Seismic Isolation Plates <http://isobase.com/>

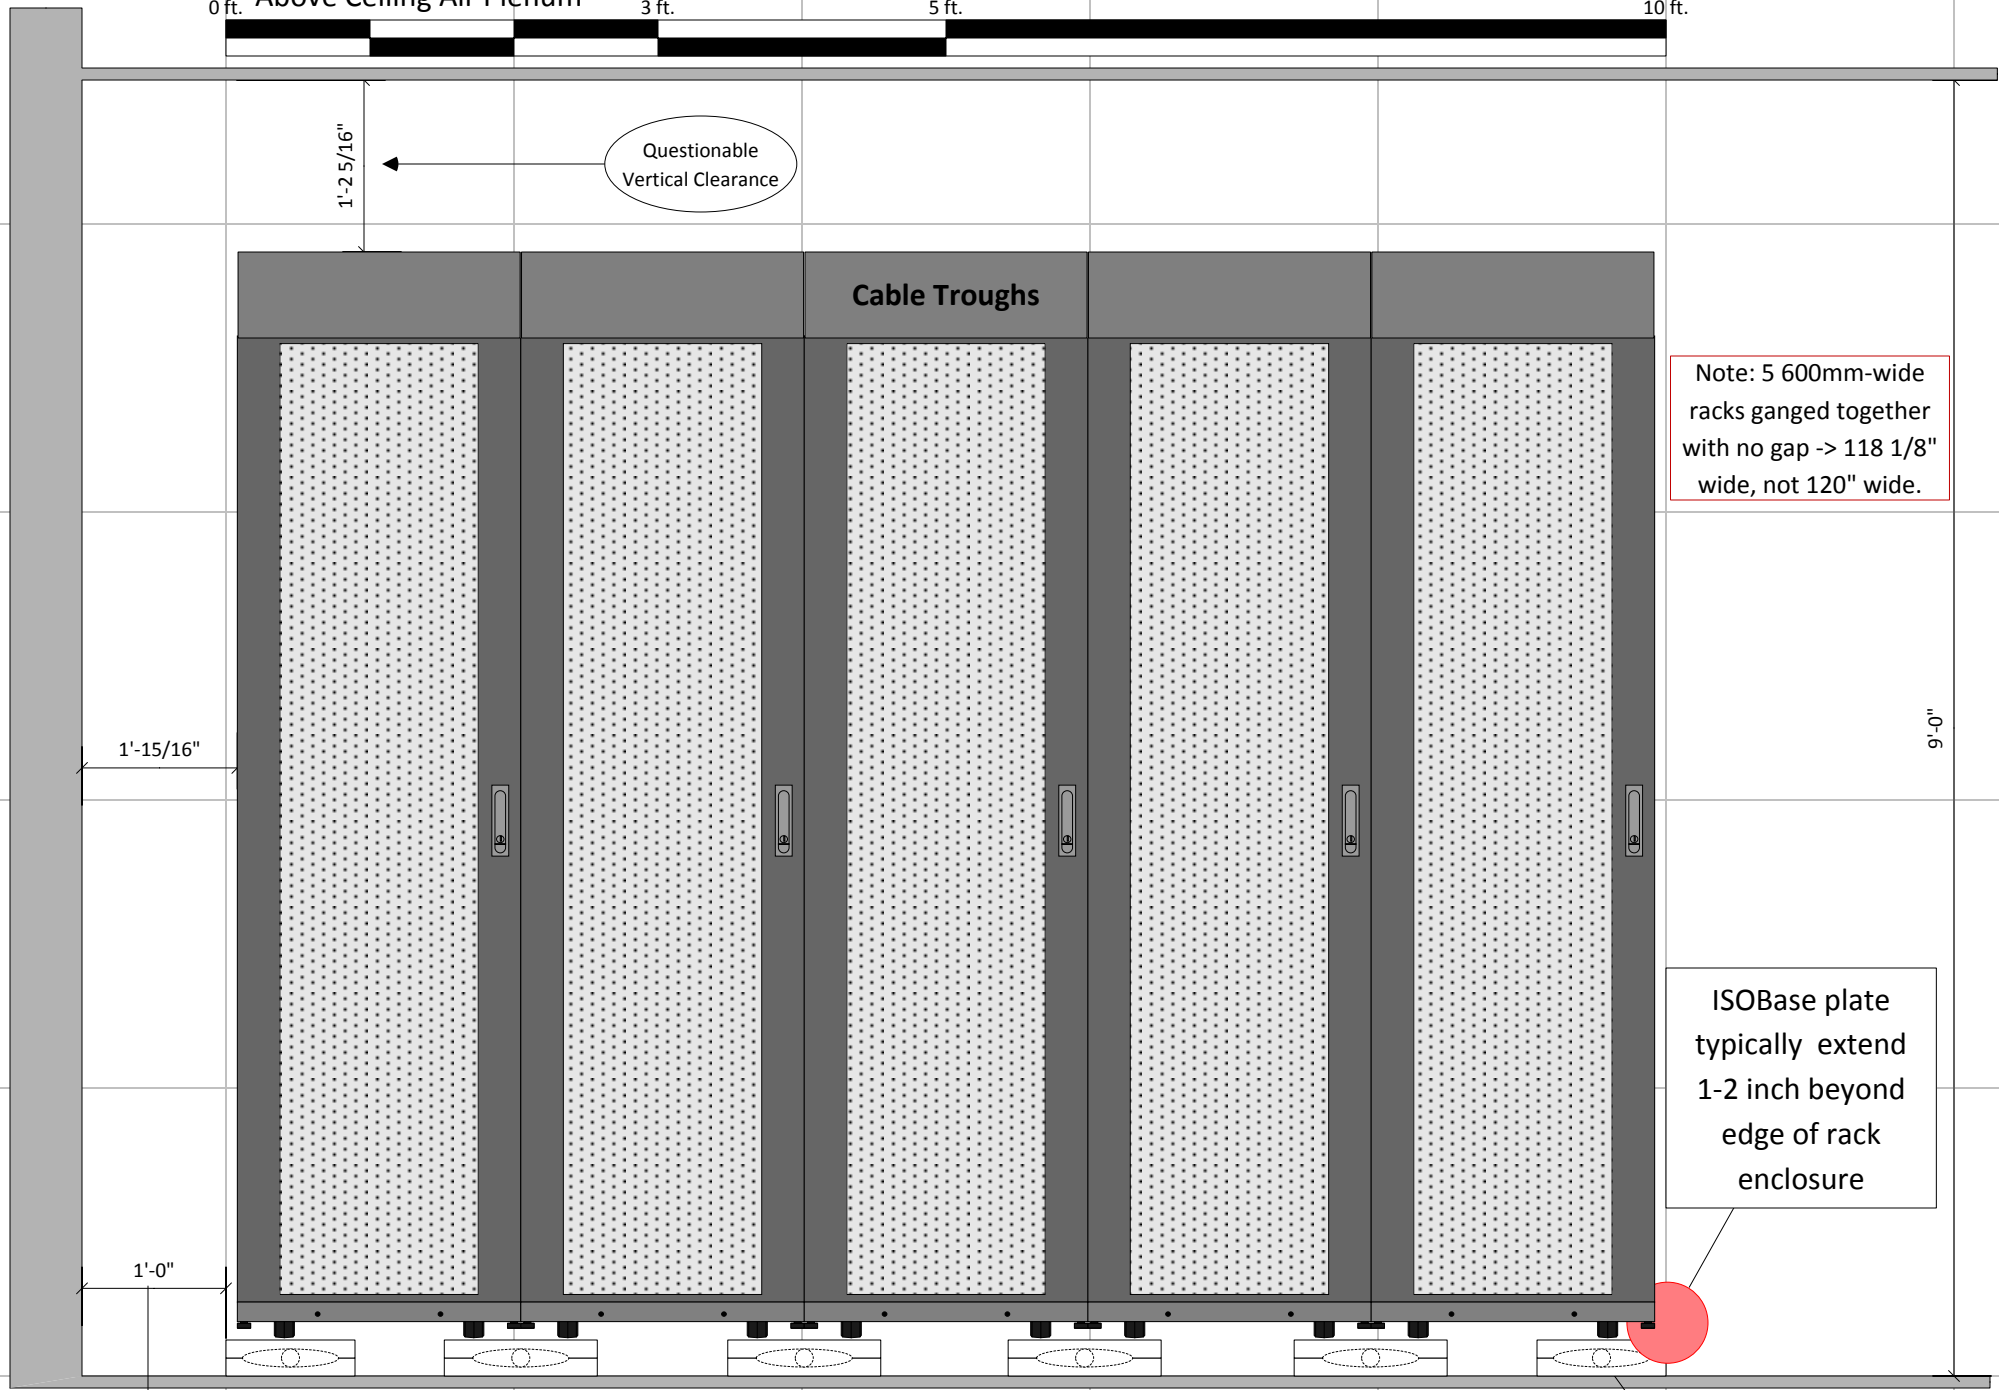

0 ft. Above Ceiling Air Plenum 3 ft. 5 ft. 10 ft.

9"
Likely insufficient Vertical clearance

Cable Troughs

Note: 5 600mm-wide racks ganged together with no gap -> 118 1/8" wide, not 120" wide.

1'-15/16"

9'-0"

ISOBase plate typically extend 1-2 inch beyond edge of rack enclosure

1'-0"

Min 9" between ISOBase and wall/objects

Seismic Isolation Plates
<http://isobase.com/>



Above Ceiling
Air Plenum

